


ENERGY FLOW DIAGRAM FOR TRANSMISSION LOSSES (2015- 2016)

INPUT ENERGY IN KPTCL GRID = 81967 MU
ENERGY AT INTERFACE POINT = 78770 MU
PERCENTAGE TRANS LOSSES = 3.90 %

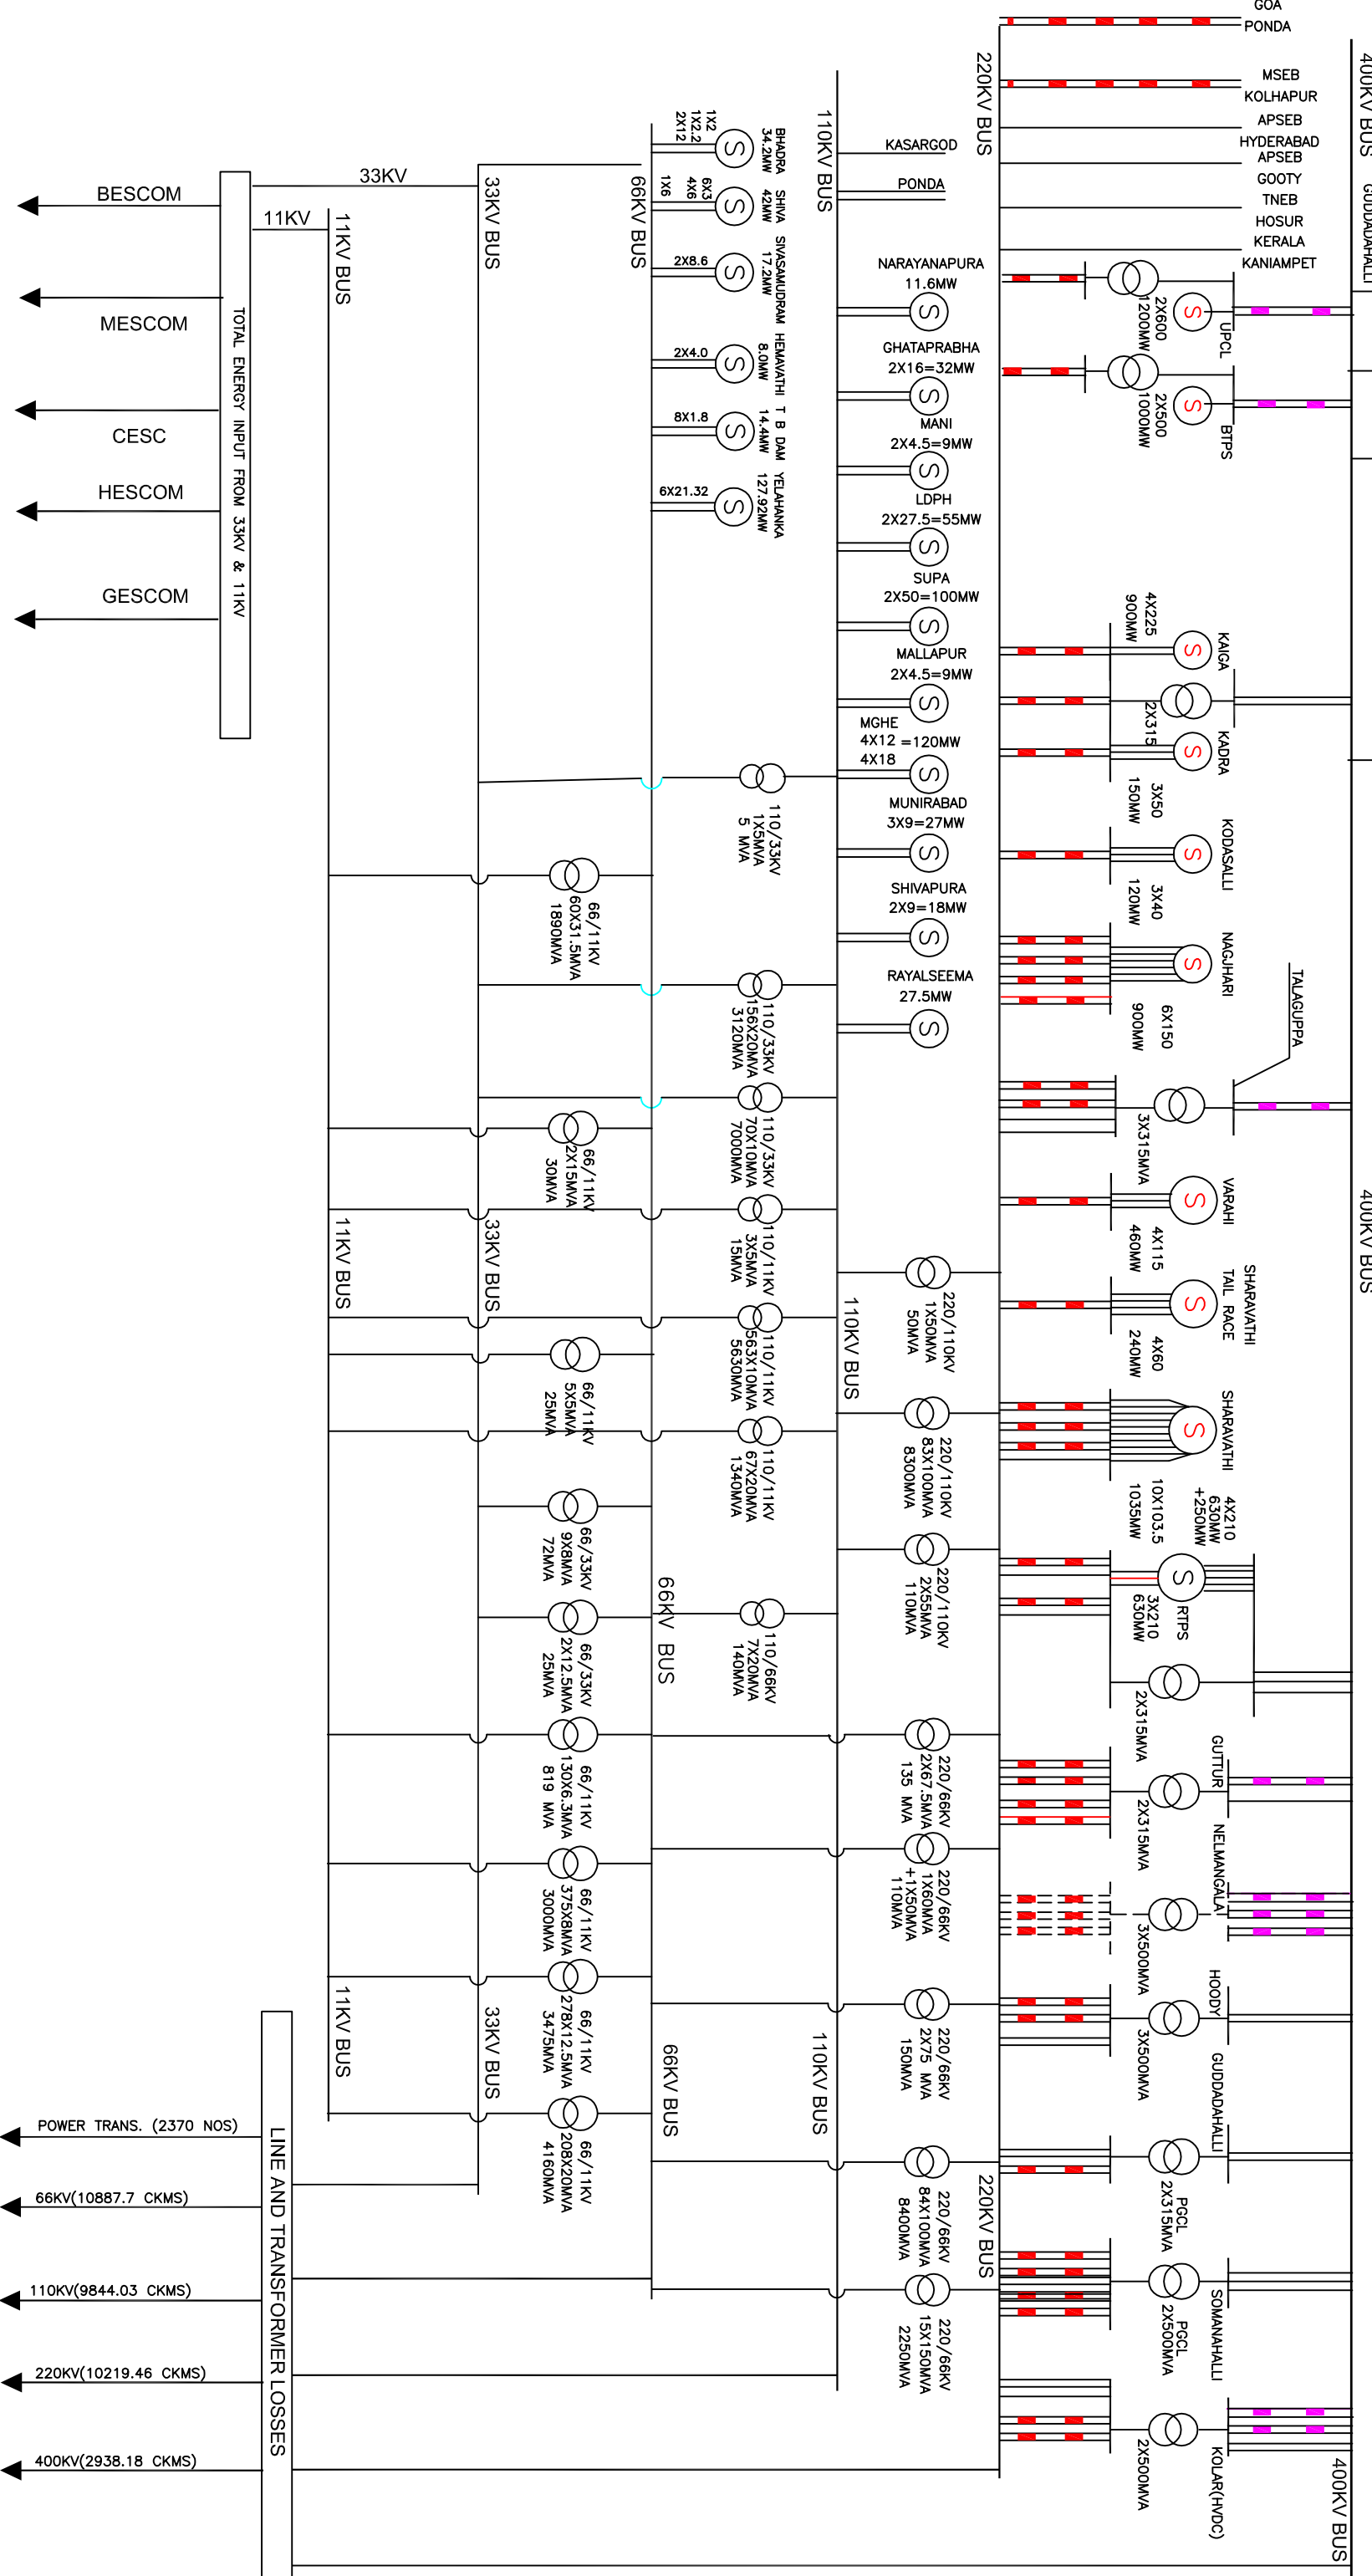

ENERGY SOLD BY ESCOM

TOTAL ENERGY INPUT FROM 33KV & 11KV

BESCOM

MESCOM

CESC

HESCOM

GESCOM